

CHAMUNDESHWARI ELECTRICITY SUPPLY CORPORATION LIMITED

Estimate No HC-266

Date..... 04/10/2023

(Estimate for Temporary power supply is an extent of 01 HP/KW for the)
purpose of Building construction

..... for a period..... 60 Days of

Sri/Smt. S.S. Jagadeesh S/o Late

S.N. Siddagouda at Ballenahally Village
in Hagare section Bellur SLA

SL NO.	Particulars	Unit	Qty	Single phase	Three phase
1	Single phase/ 3 phase meter	No.	1	630.00	3920.00
2	RC cutout etc			70.00	80.00
3	Cost of the Labour			50.00	100.00
4	Employees cost at 20% on above			150.00	820.00
5	Transportation charges			25.00	25.00
6	Miscellaneous materials			75.00	80.00
7	Contingency at 5% on above			50.00	251.00
8	Total cost of the estimate			1050.00	5276.00
9	Service charges at 10% on item no 8			105.00	527.00
10	Cost of returnable materials credit	No.		630.00	3920.00
11	Net cost the estimate			525.00	1884.00

Certificate: Certified that I have inspected the spot personally and prepared the estimate as per the current schedule of rates for most economical and safe way of executing the work.


Report: The Transformer 63KVA KVA at 431024
can taken up this additional load of 01 KW for the purpose of Building
..... Construction that load will be connected safely.

Existing load - 10hp + 20KW = proposed - 01KW

Chel
04/10/2023

DTLMS-431D34

CESC-098784

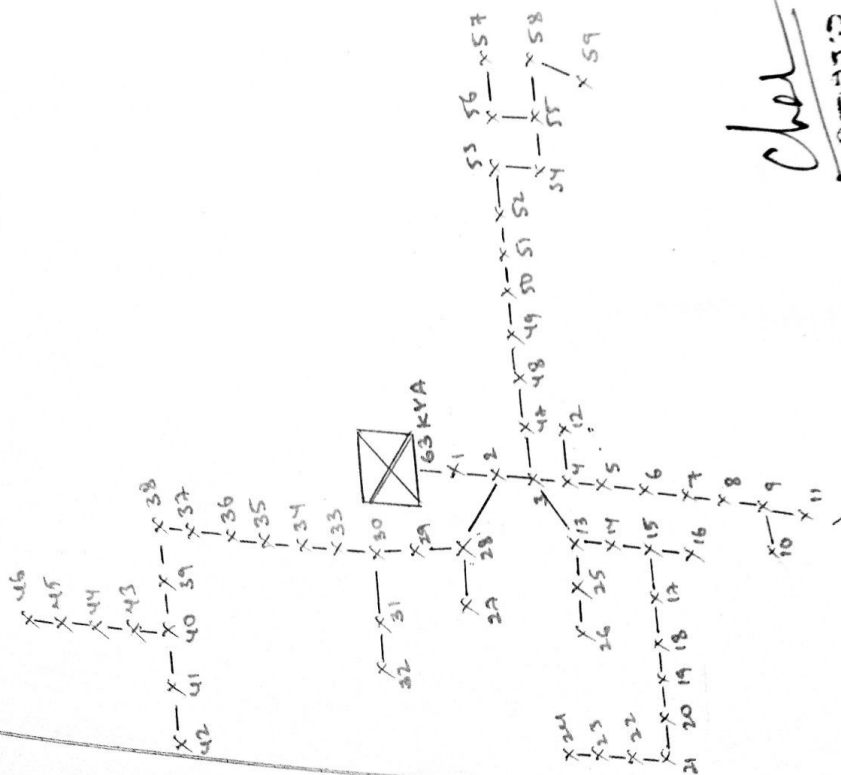

Chel

DTLMS-431D34
CESC-098784

Page No.	P.R.No.	Page No.	P.R.No.
1.	P-673	29.	IB-20905
3.	SNKSTL-1	30.	IB-62 IB-3
	IB-121		IB-209 IB-209
	SNKHP-31567		I-157 I-22076
4.	IB-20937	31.	IB-186
	IB-20938		IB-185
7.	SNKL-31450	32.	IB-174
	SNKL-31449	34.	IB-242 IB-83
	I-228		IB-243
	IB-23926		SNKL-24971
10.	I-23438	36.	IBJ-60
11.	IB-36762	39.	IB-62 SNKJ-6
16.	SNKL-36752	41.	IB-244 IB-95
	SNKL-36753	42.	SNKJ-4 IB-31
17.	SNKHP-33730	44.	IB-68 SNKJ-5
18.	IB-28102	56.	IB-151
	IB-28103	57.	SNKL-31383
	IB-28104	58.	I-190
	IB-28105	59.	IB-189
19.	IB-28106	53.	IB-27785
20.	I-112		
21.	SNKJ-1		
25.	IB-7 IB-6		
27.	I-178		
	IB-23049		

chanda's