



CHAMUNDeshwari ELECTRICITy SUPPLY CORPORATION LIMITED

CESC. BELUR SUB-DIVISION,

Estimate No. HC-267

Date: 01/10/2023

Estimate for arranging Temporary Power Supply to an extent of 01 KW for Building

Construction Purpose for a period of 60 Days in favour of Sri/Smt. Rathna W/O

Subramanya at Hagare village

Hagare CSD, Hassan

Sl No.	Particulars	Unit	Qty	Single Phase	Three Phase
1.	Single Phase / Three Phase				
2.	P.C. Cutout etc.,	Nos	1	1000.00	3920.00
3.	Miscellaneous Materials	Set	1	70.00	80.00
4.	Cost of the Labour			80.00	100.00
5.	Employees cost @ 20% on above			50.00	100.00
6.	Contineny @ 5% on above			20.00	40.00
7.	Transporation Charges			24.00	84.00
8.	Total Cost of the estimate			200.00	200.00
9.	Service charges at 10% on Item No. 8			144.00	452.00
10.	Cost of the returnable materials (Engergy Meter)	Nos	1	1000.00	3920.00
11.	Net cost of the estimate			588.40	1056.00

Certificate : Certified that I have personally inspected the spot and prepared the estimate as Per current SR for safe and economical way of executing the work

Report : The Transformer of Capacity 25 KVA, at Hagare

DTC Code U35411 can taken up this additional load of 01 HP/KW
Safely.

Existing load - 20 KW + Prop - 01 KW

Asst. Engineer
O & M BELUR
Hagare

ಚಾಮುಂಡೇಶ್ವರಿ ವಿದ್ಯುತ್ ಸ. ನಿ. ನಿ., ಬೇಲೂರು

ಲೆಕ್ಕ ಶೀರ್ಷಿಕೆ

ಕಾರ್ಯ ಆದೇಶ

ಕ್ರಮ ಸಂಖ್ಯೆ


ಮಂಜೂರಾತಿ ಅಂಶಗಳಲ್ಲಿ

ಮಂಜೂರಾತಿ ಅಕ್ಷರಗಳಲ್ಲಿ

ಸ. ಕಾ. ಇಂಜಿನಿಯರ್ (ವಿ)
ಉಪವಿಭಾಗ, ಬೇಲೂರು

ಸಹಾಯಕ ಇಂಜಿನಿಯರ್ ತಾ (ವಿ)
ಉಪವಿಭಾಗ, ಬೇಲೂರು

HAGARE SHANTHALHANASARA 25Kva Rggy. D.T.C. Code 4-35

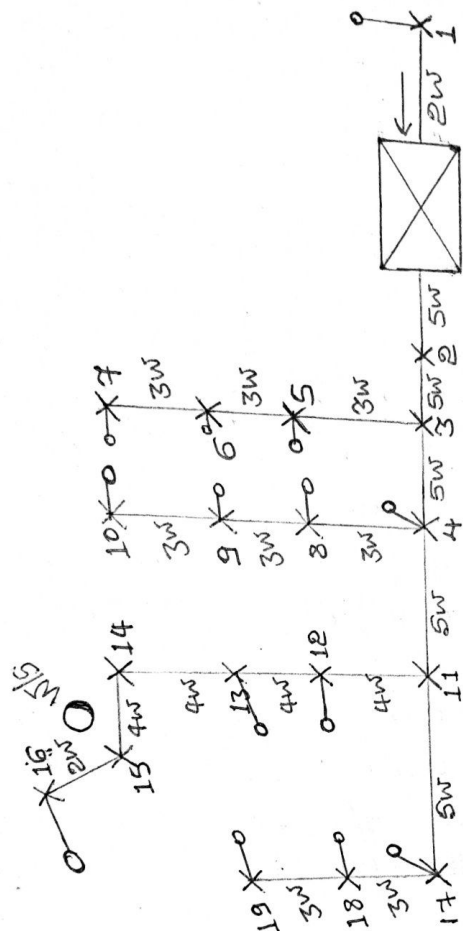

Pole No.	R.R. NO	TARIK	NO.
1			
4	a) HL19115	LT ₂	
	b) Rggy HL26	LT ₂	
7	a) Rggy HL25	LT ₂	
	b) Rggy HL19	LT ₁	
8	a) Rggy HL28	LT ₁	
	b) Rggy HL29	LT ₁	
9	a) Rggy HL23	LT ₁	
10	a) Rggy HL24	LT ₁	
12	a) Rggy HL32	LT ₁	
	b) Rggy HL17	LT ₁	
	c) HL28551	LT ₂	
13	a) HL18561	LT ₂	
	b) Rggy HL21	LT ₁	
18	a) HL534	LT ₂	
	b) Rggy HL33	LT ₁	
	c) Rggy HL36	LT ₁	
19	a) Rggy HL35	LT ₁	
	b) 11-25		
	c) Rggy HL13		
16	a) HL16525	LT ₂	
15	a) HP288	LT ₆	

[Handwritten signature and stamp]