


Bootharagudi

D.T.C. Code:- H3571114

ಇ.ಇ.ವಿ. ಶಿವಮೊಗ್ಗವೆಲ್ಲ
ಮಂತ್ರನುಡಿ

H3571114

41 span

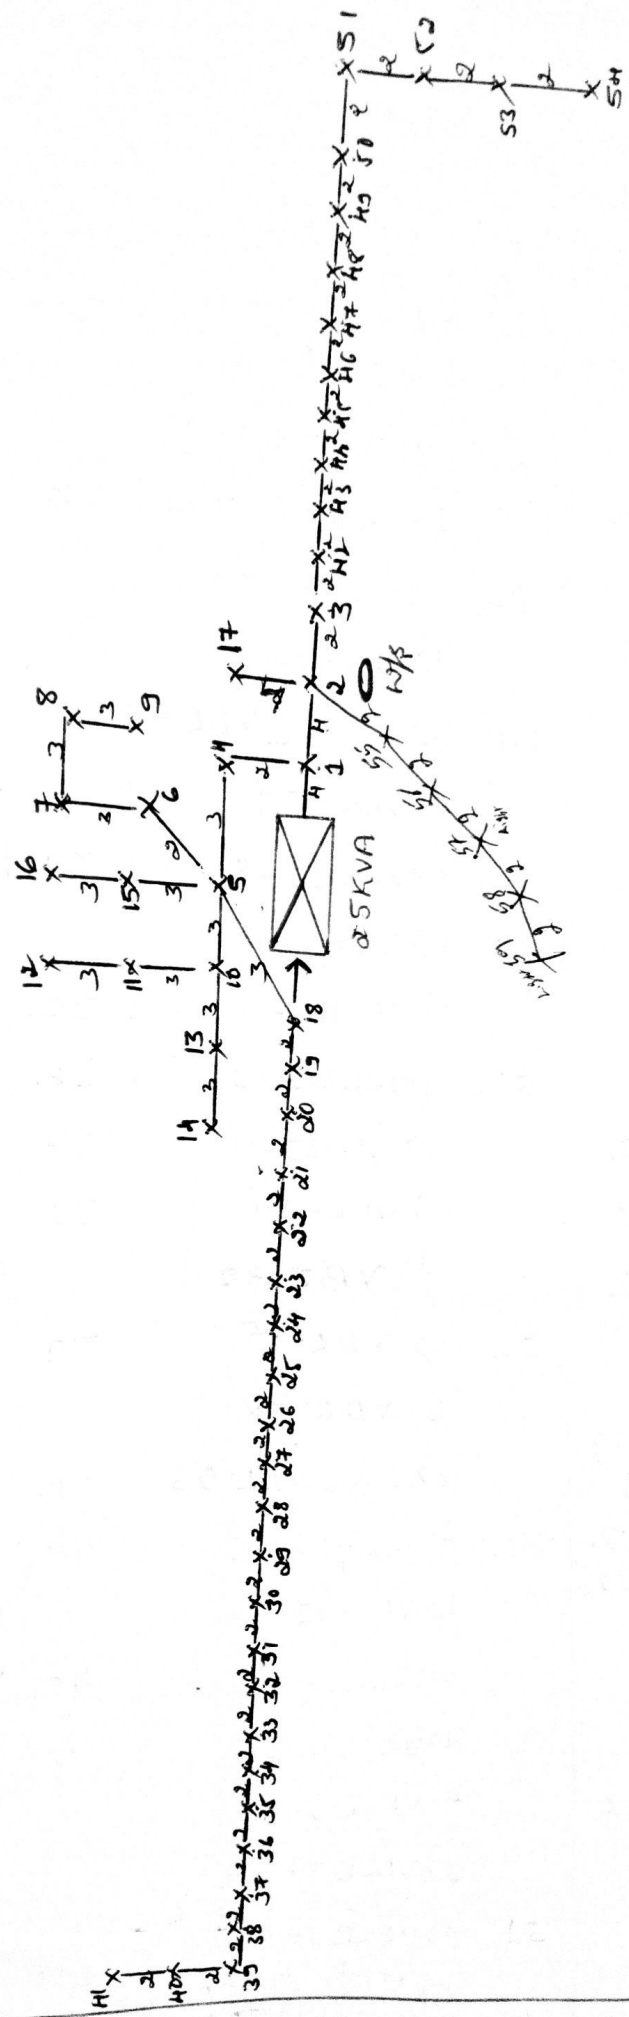

Cher
ಶಿವಮೊಗ್ಗ (2)
ಕೆ.ಎಂ.ಎ.ಎ.
ಇ.ಇ.ವಿ.ಎ.

AMUNDRESHWARI ELECTRICITY SUPPLY CORPORATION LIMITED

Estimate No. HC-326 Date 21/11/2023

Estimate for Temporary power supply is an extent of 01 HP/KW for the purpose of Building Construction

for a period 60 Days of

B.S. Malleeshas/o Siddabhotgi

at Shirvapure Kallur Village

in Hagase Section Belur SLW

NO.	Particulars	Unit	Qty	Single phase	Three phase
	Single phase/ 3 phase meter	No.	1	630.00	3920.00
	RC cutout etc			70.00	80.00
	Cost of the Labour			50.00	100.00
	Employees cost at 20% on above			150.00	820.00
	Transportation charges			25.00	25.00
	Miscellaneous materials			75.00	80.00
	Contingency at 5% on above			50.00	251.00
	Total cost of the estimate			1050.00	5276.00
	Service charges at 10% on item no 8			105.00	527.00
	Cost of returnable materials credit	No.		630.00	3920.00
	Net cost the estimate			525.00	1884.00

Certificate: Certified that I have inspected the spot personally and prepared the estimate as per the current schedule of rates for most economical and safe way of executing the work.

Report: The Transfomer 25 KVA at DTC-435744

an taken up this additional load of 01 KW for the purpose of Building Construction

that load will be connected safely.

Existing load 5hp + 15 KW