


CERTIFICATE: Certified that I have personally visited the spot and prepared this estimate using current in most economical and safe way for execution of work.

REPORT:- This estimate prepared of Rs **165311** for APS of 10HP Power installation (ment Bricks) in F/o Smt. Nousheen Banu W/o Babu at SNo 63/6 limits of Hebbadi village limits in Naguvanahalli Section S.R Patna sub division.
Proposed to erection of DTC structure on existing 11KV line. And provide 25KVA TC DPST structure on existing 11KV line of F3 NJY Bonthagalli feeder from Taripura MUSS. LT line is extend for 10mtr and proposed 25KVA DTC and service the proposed power installation. HTVR is with in the limit, HTVR & connection details are enclosed with this estimate.
necessary line materials and labour charges are made provision in this estimate. Hence this estimate kindly be sanctioned as early.

SKETCH

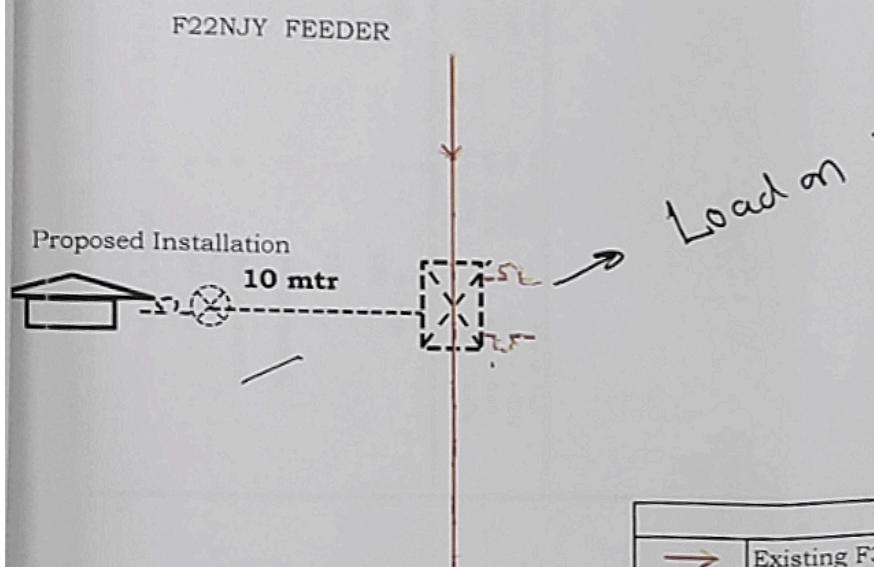

INDEX	
	Existing F3 NJY Feeder
	Proposed 25KVA TC
	Proposed HT line with 9M RCC/PSC poles
	Proposed LT GuySet
	Existing LT Line
	Proposed HT Guy set
	Proposed Stud Pole

Asst. Executive Engineer (Ele)
CESC, S.R.Patna Sub-Division

Junior Engineer (Ele), CESC,
Naguvanahalli section S.R.Patna