



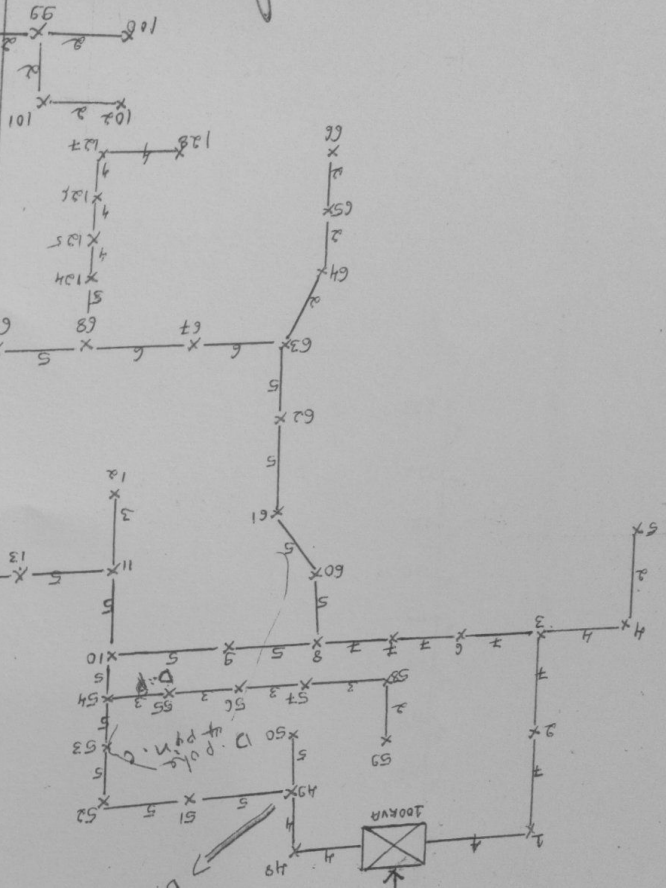

Handwritten signature and notes at the top of the right page.

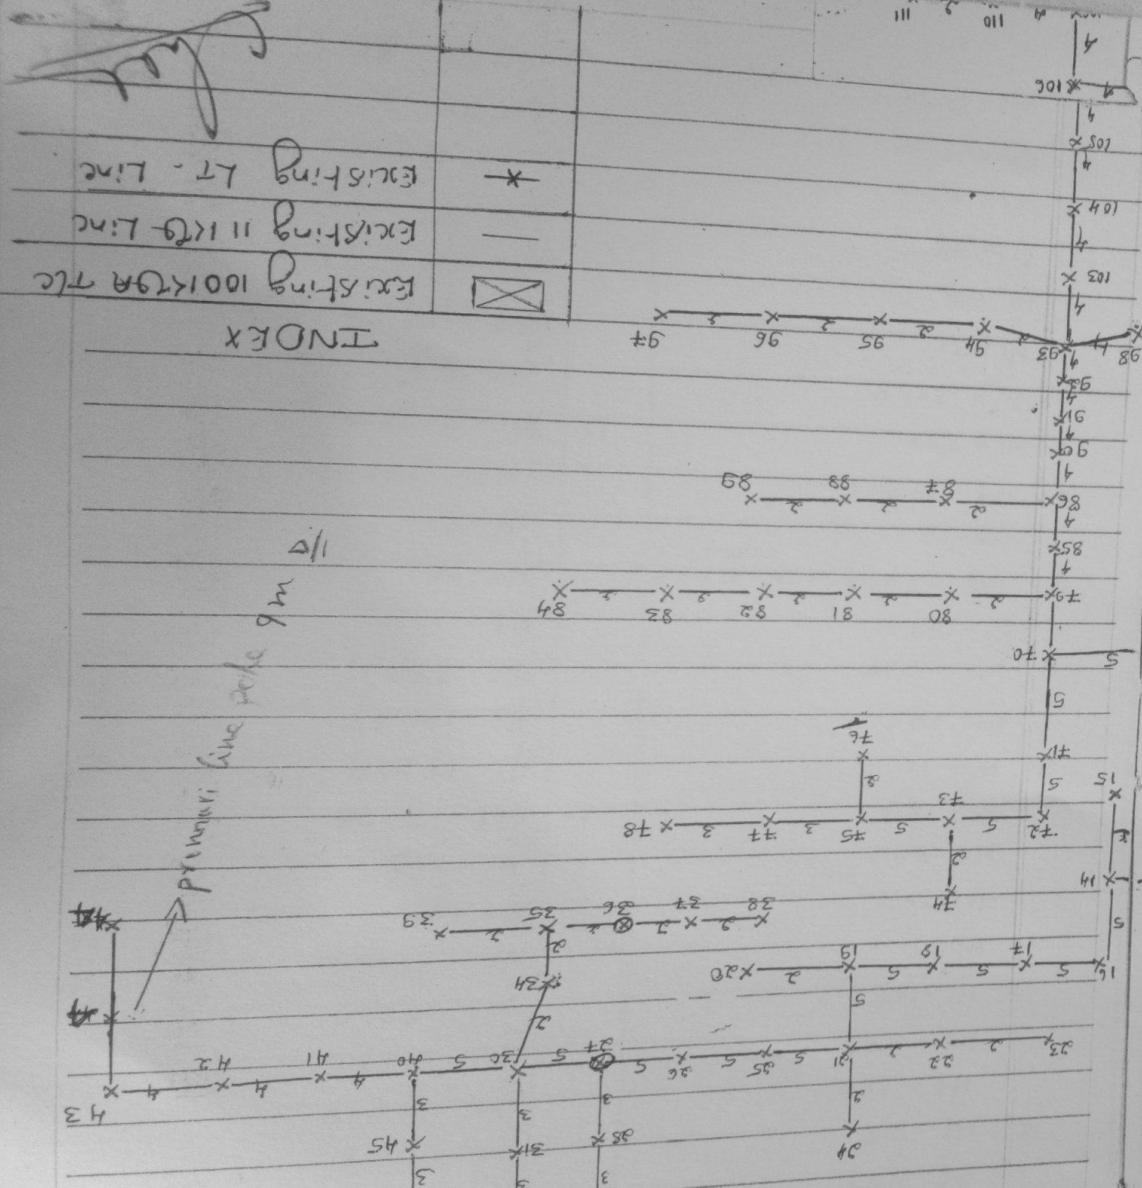

Existing 100KVA T/C	⊠	
Existing 11 KV-Line	—	
Existing LT-Line	-x-	

INDEX

Handwritten notes and arrows pointing to specific parts of the diagram.

Estimate No HC 5

Date 10/04/2024

(Estimate for Temporary power supply is an extent of 0.1 HP/KW for the)

purpose of Building construction

..... for a period 60 Days of

Sri/Smt. Kumara Shamy s/o Late. B. Hanumanthaia

at Hagare village in Hagare section Belga

SL NO.	Particulars	Unit	Qty	Single phase	Three phase
1	Single phase/ 3 phase meter	No.	1	630.00	3920.00
2	RC cutout etc			70.00	80.00
3	Cost of the Labour			50.00	100.00
4	Employees cost at 20% on above			150.00	820.00
5	Transportation charges			25.00	25.00
6	Miscellaneous materials			75.00	80.00
7	Contingency at 5% on above			50.00	251.00
8	Total cost of the estimate			1050.00	5276.00
9	Service charges at 10% on item no 8			105.00	527.00
10	Cost of returnable materials credit	No.		630.00	3920.00
11	Net cost the estimate			525.00	1884.00

Certificate: Certified that I have inspected the spot personally and prepared the estimate as per the current schedule of rates for most economical and safe way of executing the work.

Report: The Transformer 100 KVA at Hagare Town

can taken up this additional load of 1 KW for the purpose of Building

Construction

that load will be connected safely.

[Signature]
 2024/04/10
 10:00 AM
 10:00 AM