


nanaka TC :-
25 KVA
DTCCODE:- 435612

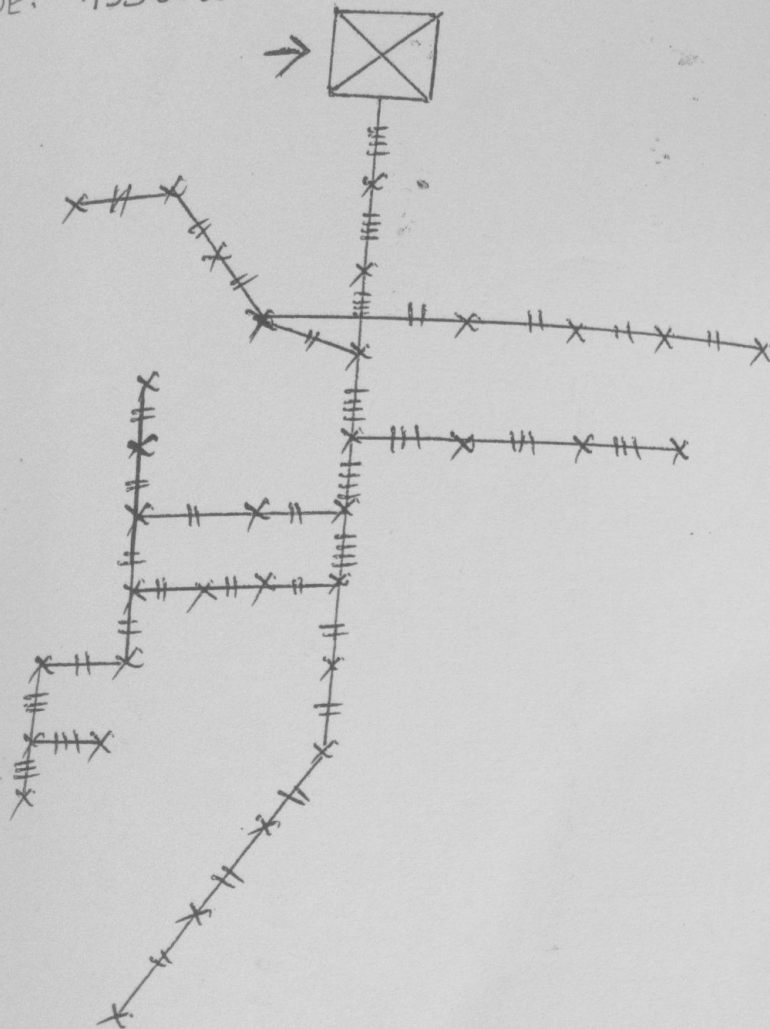

INDEX:-

	Existing 25 KVA TC
	Existing LT line
	Existing four line to proposed 5 wire
	Existing three line
	Existing two line to proposed 3 wire

Cher
SUNSHINE IN
TO THE
WALLS AND

CHAMUNDESHWARI ELECTRICITY SUPPLY CORPORATION LIMITED

Estimate No. HC 538 Date 26/03/2024

(Estimate for Temporary power supply is an extent of 01 HP/KW for the)

purpose of Building construction for a period 60 Days of

Sri/Smt. Manjogonda s/o Kamanigonda
at Yalahanka Village in Hagave
Section Belav S/B.

SL NO.	Particulars	Unit	Qty	Single phase	Three phase
1	Single phase/ 3 phase meter	No.	1	630.00	3920.00
2	RC cutout etc			70.00	80.00
3	Cost of the Labour			50.00	100.00
4	Employees cost at 20% on above			150.00	820.00
5	Transportation charges			25.00	25.00
6	Miscellaneous materials			75.00	80.00
7	Contingency at 5% on above			50.00	251.00
8	Total cost of the estimate			1050.00	5276.00
9	Service charges at 10% on item no 8			105.00	527.00
10	Cost of returnable materials credit	No.		630.00	3920.00
11	Net cost the estimate			525.00	1884.00

Certificate: Certified that I have inspected the spot personally and prepared the estimate as per the current schedule of rates for most economical and safe way of executing the work.

Report: The Transformer 25 KVA at Yalahanka
can taken up this additional load of 01 KW for the purpose of Building
Construction that load will be connected safely.

Existing load - 20 KW + prop - 01 KW

[Signature]