

CHAMUNDESHWARI ELECTRICITY SUPPLY CORPORATION LIMITED

Estimate No HC-89

Date 02/06/2023

(Estimate for Temporary power supply is an extent of 01 HP/KW for the)
purpose of Building construction

for a period 0 Days of
Sri/Smt. D. T. Dharmegowda s/o D. S. Thimmegowda
at Hagare village in Hagare oam section
Belare S/O.

SL NO.	Particulars	Unit	Qty	Single phase	Three phase
1	Single phase/ 3 phase meter	No.	1	630.00	3920.00
2	RC cutout etc			70.00	80.00
3	Cost of the Labour			50.00	100.00
4	Employees cost at 20% on above			150.00	820.00
5	Transportation charges			25.00	25.00
6	Miscellaneous materials			75.00	80.00
	Contingency at 5% on above			50.00	251.00
8	Total cost of the estimate			1050.00	5276.00
9	Service charges at 10% on item no 8			105.00	527.00
0	Cost of returnable materials credit	No.		630.00	3920.00
1	Net cost the estimate			525.00	1884.00

Certificate: Certified that I have inspected the spot personally and prepared the estimate as per
the current schedule of rates for most economical and safe way of executing the work.

Report: The Transformer 25 KVA at Hagare
taken up this additional load of 01 KW for the purpose of Building
Construction that load will be connected safely.
Existing load - 10hp + 20kva

Chh
02/06/2023
02/06/2023

② TC 435405


d. T. v. Q.

2. T.V. R-2 $10 \times 0.05 + 20 \times 0.25$
+ 25×0.15

$$= 0.5 + 0.375$$

$$= 9.25 \times 10^{-6}$$

1/2 5.5 1/2

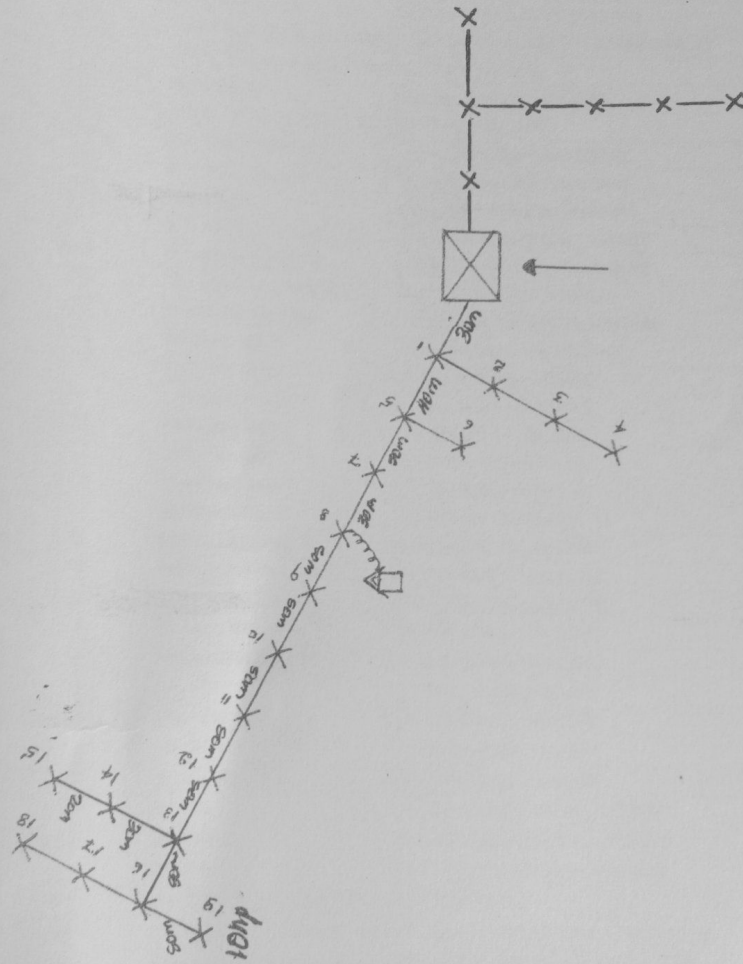

INDEX :-

	Existing 63kVA Tc
	Existing LT line
	Proposed installation

John

உருகிய கருவியை

卷之五
 五